

CLIENT: CRANE COMPOSITES
Attn: Michelle Bauer
8015 Dixon Dr.
Florence KY 41042

Test Report No: TJ1898-1	Date: February 19, 2014
---------------------------------	--------------------------------

SAMPLE ID: The Client submitted and identified the following test material as "IPSC .075."

SAMPLING DETAIL: Test samples were submitted to the laboratory directly by the client. No special sampling conditions or sample preparation were observed by QAI.

DATE OF RECEIPT: Samples were received at QAI facilities on January 30, 2014

TESTING PERIOD: February 5, 2014

AUTHORIZATION: Proposal FB-2014-012003 signed by Michelle Bauer on January 20, 2014

TEST REQUESTED: Perform standard flame spread and smoke density developed classification tests on the sample supplied by the Client in accordance with ASTM Designation E84-12, "Standard Method of Test for Surface Burning Characteristics of Building Materials". The foregoing test procedure is comparable to UL 723, ANSI/NFPA No. 255, and UBC No. 8-1.

TEST RESULTS:	<u>Flame Spread</u>	<u>Smoke Developed</u>
	70	200

CLASSIFICATION: The material tested resulted in a Class B. Detailed test results are presented in the subsequent pages of this report

Prepared By


Jeff Foster
Fire Test Technician

**Signed for and on behalf of
QAI Laboratories, Inc.**


J. Brian McDonald
Operations Manager



PREPARATION AND CONDITIONING: The sample was submitted in six panels that were 4 feet long cut to measure 24 inches wide and approximately .0690 inches thick. The sample material was placed into conditioning at 73°F (±5°F) and 50% (±5%) relative humidity until day of testing.

E 84 TEST DATA SHEET:

MOUNTING METHOD: The sample was supported during testing by 2" hexagonal mesh poultry netting running the length of the test chamber and ¼" round metal rods placed at 2' intervals across the width of the test chamber.

CLIENT: Crane Composites **DATE:** February 7, 2014

SAMPLE: IPSC.075

IGNITION: 0 minutes, 43 seconds

FLAME FRONT: 15 feet maximum

TIME TO MAXIMUM SPREAD: 2 minute, 30 seconds

TEST DURATION: 10 minutes, 00 seconds

SUMMARY: **FLAME SPREAD:** 70 (70.4 unrounded) **SMOKE DEVELOPED:** 200 (217 unrounded)

OBSERVATIONS:

Audible crackling could be heard 40 seconds into test. Sustained ignition and charring both occurred at 43 seconds. Significant flame spread increase of the product up to window 15. Product burn slowly decreased down, no significant changes through remainder of test. Test concluded at 10 minutes with no after burn.

CALIBRATION DATA:

Time to Ignition of Last Red Oak (sec):	57
Red Oak Smoke Area (%A* Min):	111
Total Fuel Burned (ft ³)	59.68



SUMMARY OF ASTM E84 RESULTS:




Because of the possible variations in reproducibility, the results are adjusted to the nearest figure divisible by 5. Smoke Density values over 200 are rounded to the nearest figure divisible by 50.

In order to obtain the Flame Spread Classification, the above results should be compared to the following table:

<u>NFPA CLASS</u>	<u>IBC CLASS</u>	<u>FLAME SPREAD</u>	<u>SMOKE DEVELOPED</u>
A	A	0 through 25	Less than or equal to 450
B	B	26 through 75	Less than or equal to 450
C	C	76 through 200	Less than or equal to 450

BUILDING CODES CITED:

1. National Fire Protection Association, ANSI/NFPA No. 101, "Life Safety Code", 2006 Edition.
2. International Building Code, 2006 Edition, Chapter 8, Interior Finishes, Section 803.

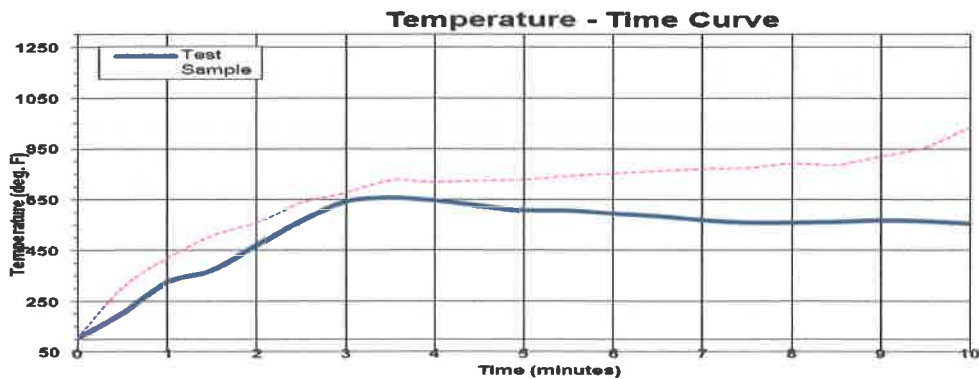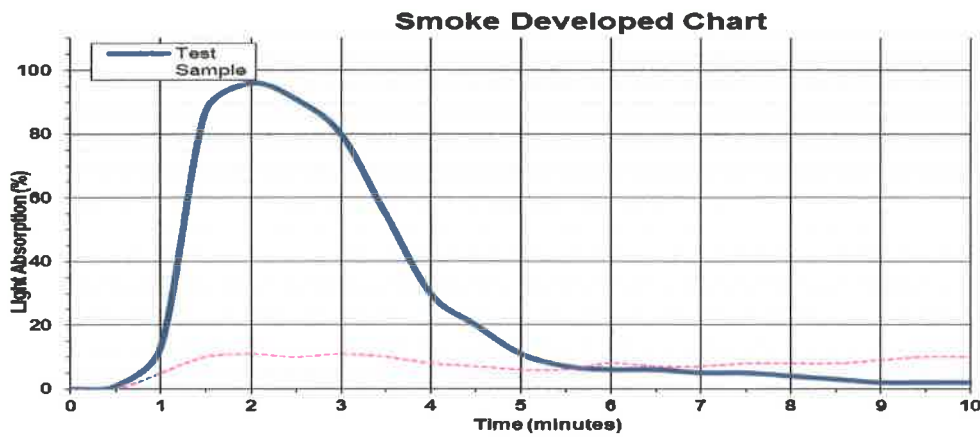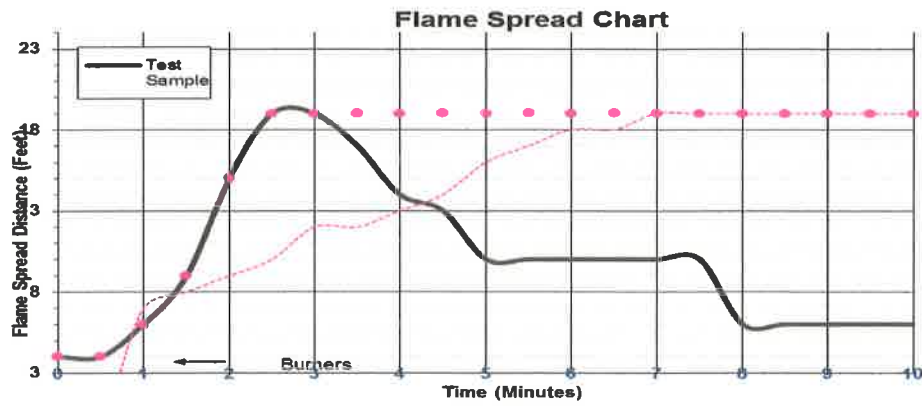

END OF REPORT